

VOLTAGE REGULATION USING DROOP CONTROL BASED STATCOM FOR WIND ENERGY APPLICATIONS

¹D.Neeraj, ²K.Punithavel, ³B.Srinivaas, ⁴G.Muthuselvi ⁴M.Sudhakaran

^{1,2,3}Dept of EEE, GTEC, Vellore, India

⁴Asst. Prof, Dept of EEE, GTEC, Vellore, India

⁵Associate Prof, Dept of EEE, GTEC, Vellore, India

Abstract:

For the past few year renewable energy resources, without challenging environmental concerns has lead to significant increase in global power generation. Out of that wind energy is considered to be the most mature renewable energy source. However, the exploitation of wind energy is particularly challenging due to the stochastic nature of wind. This weak interconnection of wind generating source in the electrical network affects the power quality and reliability. FACTS technologies have already been used to enhance the controllability and power transfer capability of transmission system. Recently other important functions have been added such as harmonic elimination and dynamic voltage regulation, as a solution for power quality problems. In this paper FACTS device is used to enable smooth and proper integration of wind energy system to the grid is taken as the main objective. Furthermore, the detailed investigations using MATLAB/SIMULINK is explored in this paper for the enhancement of power quality using STATCOM, integrated with battery energy storage system. The STATCOM model is tested using a hardware setup.

Keywords: BESS, FACTS, hysteresis current control, power quality, statcom.

1. INTRODUCTION

New energy source has become a focus for global economic growth and sustainable development with the depletion of resources and pollution of environment. This diverts researchers' attention towards renewable energy resources such as wind energy, solar energy, fuel cell, geothermal, biomass, and industrial waste heat [1,2]. Wind power is gaining momentum not only as a means to reduce the CO₂ emissions but also as an interesting economic alternative in areas with appropriate wind speeds [3]. The challenges the wind power introduce to the power system is related to the fluctuating nature of wind energy as well as the asynchronous generators that are introduced to the power system [4]. Asynchronous generators are connected to grid through the power converter and thus the power fluctuations caused by the variation in wind speed are absorbed and compensated by adjusting the generated frequency and the voltage to the grid [5]. The FACTS devices such as Static Var compensator (SVC), a combination of the thyristor-controlled reactors and fixed capacitors (FC-TCR) has made it possible to provide dynamic compensation of reactive power for power systems [6,7]. However, the effective reactive power that SVC can generate depends up on its terminal voltage. Thus due to voltage drop at the terminal bus the maximum reactive power output from SVC is always depressed than required, leading to controller saturation and prolonged response time. STATCOM similar to SVC is a shunt connected device but it uses the Voltage Source Inverter (VSI) for dynamic reactive power generation and absorption rather than using capacitors and inductors [8]. VSI output voltage and current can be varied by properly controlling the modulation index. This means that dynamic exchange of reactive power flow control between STATCOM and transmission line is possible independent of terminal voltage variation. Another advantage

is that STATCOM behaves analogously to synchronous condensers, except that STATCOMs have no mechanical inertia and are therefore capable of responding much more rapidly to changing system conditions and they do not contribute to short circuit currents. The integration of Battery Energy Storage System (BESS) with STATCOM provides significant improvements in the performance over conventional STATCOM [9],[10]. The addition of energy storage allows the STATCOM to inject and/or absorb active and reactive power simultaneously. In this paper, STATCOM with BESS and its control are presented. The model is implemented in MATLAB/Simulink and computer simulation results are analyzed for transient stability.

2. POWER QUALITY STANDARDS

As stated the injection of wind power into grid will affect the power quality. As the power quality must be within certain limits to comply with the utility requirement, the effect should be assessed prior to installation of the turbine. The effects depend upon the electrical characteristics of wind turbine which are manufacturer specific rather than the site specific. International Electro technical Commission (IEC) seeing need of consistent and replicable documentation of power quality characteristics of wind turbine developed IEC 61400-21 and most large wind turbine manufacturer provided power quality characteristic data accordingly. Flexible AC Transmission Systems (FACTS) refers to a group of resources used to overcome certain limitations in the static and dynamic transmission capacity of electrical networks. The IEEE has given the definition for FACTS as “alternating current transmission systems incorporating power-electronics based and other static controllers to enhance controllability and power transfer capability” [7]. The main purpose of FACTS devices is to provide with necessary instantaneous inductive or capacitive reactive power as quickly as possible in accordance with network requirement, while also improving transmission quality and the efficiency of the power transmission system. As the name indicates, Static Synchronous Compensator (STATCOM) is similar to the synchronous condenser in its operation; however it is an electronic device which has no inertia and is superior to the synchronous condenser as it provides better dynamics, a lower investment cost and lower operating and maintenance costs. A STATCOM can be seen as a voltage source behind a reactance. It provides reactive power generation as well as absorption purely by means of electronic processing of voltage and current waveforms in a Voltage Source Converter (VSC) [11]. One of the main disadvantages of a STATCOM (with no energy storage) is that it has limited degree of freedom and sustained action in which they can help the power grid. It has only two possible steady-state operating modes, namely inductive (lagging) and capacitive (leading). Even though STATCOM can control both the output voltage magnitude and phase angle, the independent adjustment in steady state is not possible due to the lack of significant active power capability of STATCOM. Typically, the output voltage of STATCOM is maintained in phase with the voltage at point of common coupling (PCC), which will ensure that only reactive power exchange takes place in between STATCOM and power system. However, owing to some losses present in the coupling transformer and the power electronic devices, the converter voltage will have small phase shift with respect to the PCC voltage. Thus in order to compensate these small losses, practically small amount of real power is drawn from the PCC to DC bus of VSI.

3. SYSTEM DESCRIPTION

The proposed new control strategy for the power quality improvement of grid connected wind energy system is shown in Figure-1. This controller maintains the dc voltage constant under any load variations and also ensures the unity power factor and sinusoidal supply current irrespective of the variation in the

load demand waveform and magnitude. The STATCOM with BESS is used to mitigate the power quality problems and enhancing the power transfer capability of the power system. It is not possible to extract all

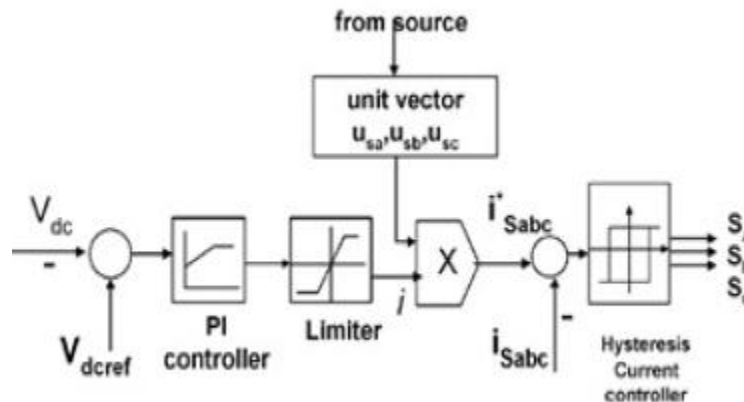


Fig.1.Current control

the kinetic energy of wind that is hitting the turbine blades, only a portion of K.E is captured by the turbine. The fundamental equation governing the mechanical power. The STATCOM based current controlled VSI injects the current into the grid in such a way that the source current is harmonic free and its phase-angle with respect to source voltage has a desired value. The injected current will cancel out the reactive part and harmonic part of the load and induction generator current. Thus source current is always maintained in phase with the source voltage, making the load appear to the source as a resistive circuit [11]. The magnitude of the reference current is regulated through the PI controller to compensate the dc voltage. The required source currents are controlled to be sinusoidal and in phase with the mains voltage in spite of the load characteristics. Therefore the reference current for the comparison must be derived from the source voltage. The instantaneous phase voltages of source (V_{sa} , V_{sb} , and V_{sc}) are considered close to sinusoidal.

4. RESULT ANALYSIS

The SIMULINK model consist of VSI inverter based STATCOM, BESS, rectifier, wind energy system, source and critical load [22]. The hysteresis current control and BESS control are embedded into the simulation. A nonlinear load consisting of diode bridge is used for simulating the system and performance of the system is observed for power quality improvement. The operation of the system without and with controller.



Fig.2.Hardware structure

The source current wave form is non sinusoidal without controller. The controller is switched on during 0.1s and the source current, inverter injected current and load waveform are observed. The source current waveform now become sinusoidal, indicating that the source current is harmonic free and STATCOM is able to compensate the reactive power requirement of the system.

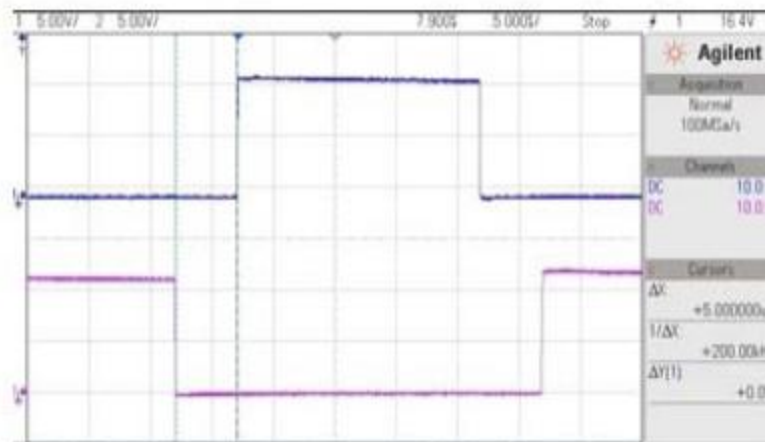


Fig.3.Output waveform

The load connected to the system is inductive. The performance of controller shows that the controller is able to maintain the source current in phase with the voltage at the point of common coupling. 5 V higher than that of the emitter for establishing the rated collector to emitter conduction. This requirement makes it difficult to directly interface an IGBT to the dSPACE. Thus a driver circuit is to be provided for driving the gate at required voltage level for triggering the IGBTs. The TLP 250 ICs are capable of providing both the isolation and driver function is chosen for this project. For the high side device bootstrap circuitry is used to provide the floating supply to drive the IGBT. Experimental setup composed of MATLAB-dSPACE interface, isolation and gate driver circuit.

CONCLUSION

This work presents a novel controller for an integrated STATCOM-Battery energy storage system for grid connected wind energy system. The control scheme focuses on eliminating the harmonics and maintaining unity power factor using VSI based STATCOM. The controller uses a very simple hysteresis current control technique to control the source current and a PI controller has been used to control the DC voltage along with the battery charging operation. The performance of the designed controller is evaluated and it is observed that the STATCOM with BESS, operated with specified controller, provides reactive power support, good harmonic mitigation as well as maintaining the source current in phase with the voltage. The STATCOM model is also tested using a scaled down hardware setup.

REFERENCES

- [1] Ackermann T. 2012. Wind Power in Power Systems. 2nd Ed. John Wiley & Sons Ltd.
- [2] C. Rubbia. 2006. Today the world of tomorrow-the energy challenge. Journal of Energy Conversion and Management. Vol. 47, pp. 2695–2697.
- [3] O. Ozgener. 2006. A small wind turbine system (SWTS) application and its performance analysis. Journal of Energy Conversion and Management. Vol. 47, pp. 1326–1337.

- [4] Zhe Chen, J.M. Guerrero and F. Blaabjerg. 2009. A review of the state of the art of power electronics for wind turbines. IEEE Transactions on Power Electronics. Vol. 24, pp. 1859–1875.
- [5] B. Singh, S. S. Murthy and Gupta S. 2014. Analysis and design of STATCOM based voltage regulator for self-excited induction generator. IEEE Transactions on Energy Conversion. Vol. 19, pp. 783–791.
- [6] Padiyar K. R. 2007. FACTS Controllers in Power Transmission and Distribution. New age International Publishers Ltd.
- [7] Narain Hingorani and Gyugi L. 2000. Understanding FACTS Concepts and Technology of Flexible AC transmission Systems. IEEE Press.
- [8] B. Gudimetla, S. Teleke and J. Castaneda. 2011. Application of energy storage and STATCOM for grid quality issues. Proceedings of the IEEE Power and Energy Society General Meet. pp. 1-8.